


NOTES

1. THIS METHOD OF SERVICE MUST BE APPROVED BY A QUALIFIED NEWNAN UTILITIES EMPLOYEE.
2. METER SOCKET MOUNTED OUTDOORS ON A PEDESTAL OR OUTSIDE WALL OF BUILDING.
3. NEWNAN UTILITIES TO MAKE ALL SERVICE LATERAL CONNECTIONS AT PADMOUNT TRANSFORMER AND CONNECTION INSIDE METER SOCKET AND SECONDARY COMPARTMENT OF TRANSFORMER.
4. C.T.s TO BE INSTALLED IN SECONDARY COMPARTMENT OF THE PADMOUNT TRANSFORMER BY A NEWNAN UTILITIES EMPLOYEE.
5. THIS METHOD OF SERVICE IS TYPICAL WHEN ONLY ONE 3 ϕ CUSTOMER IS SERVED FROM A PADMOUNT TRANSFORMER.
6. METER AND/OR METER CABINET SHALL NOT BE MOUNTED ONTO THE PADMOUNT TRANSFORMER. WITHOUT APPROVAL FROM A QUALIFIED NEWNAN UTILITIES EMPLOYEE.

METER SOCKET & PEDSTAL SUPPLIED BY NEWNAN UTILITIES, INSTALLED BY CUSTOMER.

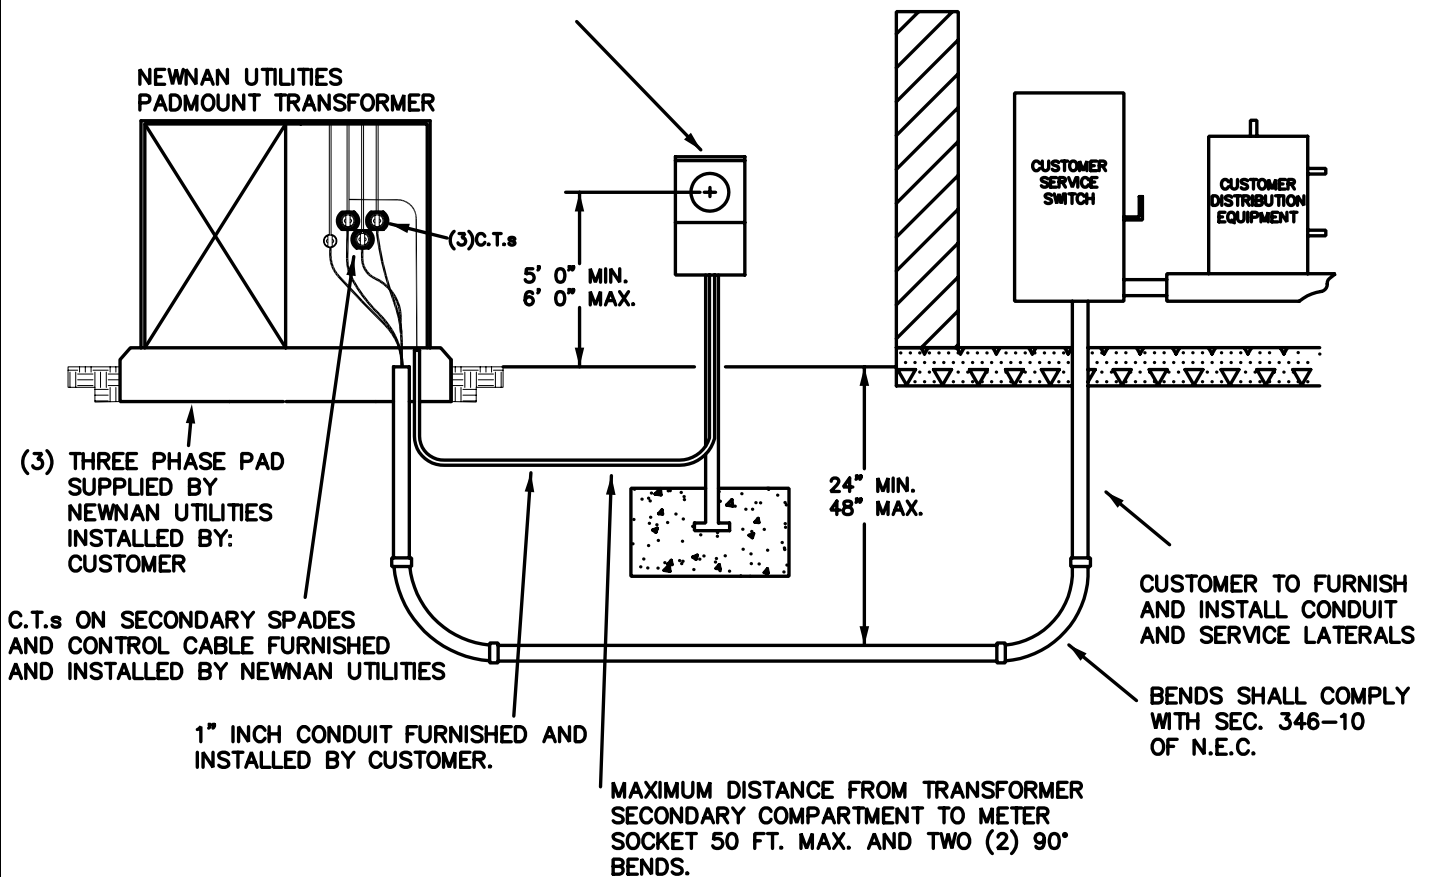

UNDERGROUND COMMERCIAL 3 ϕ TRANSFORMER
RATED METER INSTALLATION WITH ONLY
ONE CUSTOMER